STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION PERMIT

PERMIT NO. 06-0703
DATE PAID: 6-02-06
FEE PAID: 355.00
RECEIPT #:

CONSTRUCTION PERMIT FOR:
[x] New System [ ] Existing System [ ] Holding Tank [ ] Innovative
[ ] Repair [ ] Abandonment [ ] Temporary [ ] _____

APPLICANT: Hillsborough County Sheriff Office

PROPERTY ADDRESS: 14063 S. Highway 39

LOT: NA BLOCK: NA SUBDIVISION: NA
[SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
PROPERTY ID #: 088549.0000 [OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SAFTISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

w/filter

T [~~500~~ 1200] GALLONS/GPD SEPTIC TANK/AEROBIC UNIT CAPACITY MULTI-CHAMBERED/IN-SERIES [ ]
A [ ] GALLONS/GPD _____ CAPACITY MULTI-CHAMBERED/IN-SERIES [ ]
N [ ] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK: 1250 GALLONS]
K [~~225~~ 600] GALLONS DOSING TANK CAPACITY [ ] GALLONS @ [ ] DOSES PER 24 HRS # PUMPS [1]

D [~~333~~ 528] SQUARE FEET PRIMARY DRAINFIELD SYSTEM
R [ ] SQUARE FEET _____ SYSTEM
A TYPE SYSTEM: [ ] STANDARD [x] FILLED [ ] MOUND [ ] _____
I CONFIGURATION: [x] TRENCH [ ] BED [ ] _____
N
F LOCATION OF BENCHMARK: Orange Dot Base of Fence Post
I ELEVATION OF PROPOSED SYSTEM SITE [8] [INCHES] [BELOW] REFERENCE POINT
E BOTTOM OF DRAINFIELD TO BE [13] [INCHES] [BELOW] REFERENCE POINT
L
D FILL REQUIRED: [13] INCHES EXCAVATION REQUIRED: [33] INCHES

O Maintain 75 Feet from stormwater pond. Contractor responsible for
T installing proper category tank. Visual excavation check required prior to backfilling.
H Maintain 100ft from potable well. Toe of slope to be 5FT from property line. Maintain all other
E setbacks. IM Operating Permit application required prior to final approval.
R Sod slopes as needed.

SPECIFICATIONS BY: Jeremy Buchanon JB TITLE: ESI

APPROVED BY: [signature] TITLE: ESII H. CHD

DATE ISSUED: 6-27-06 EXPIRATION DATE: 12-27-07

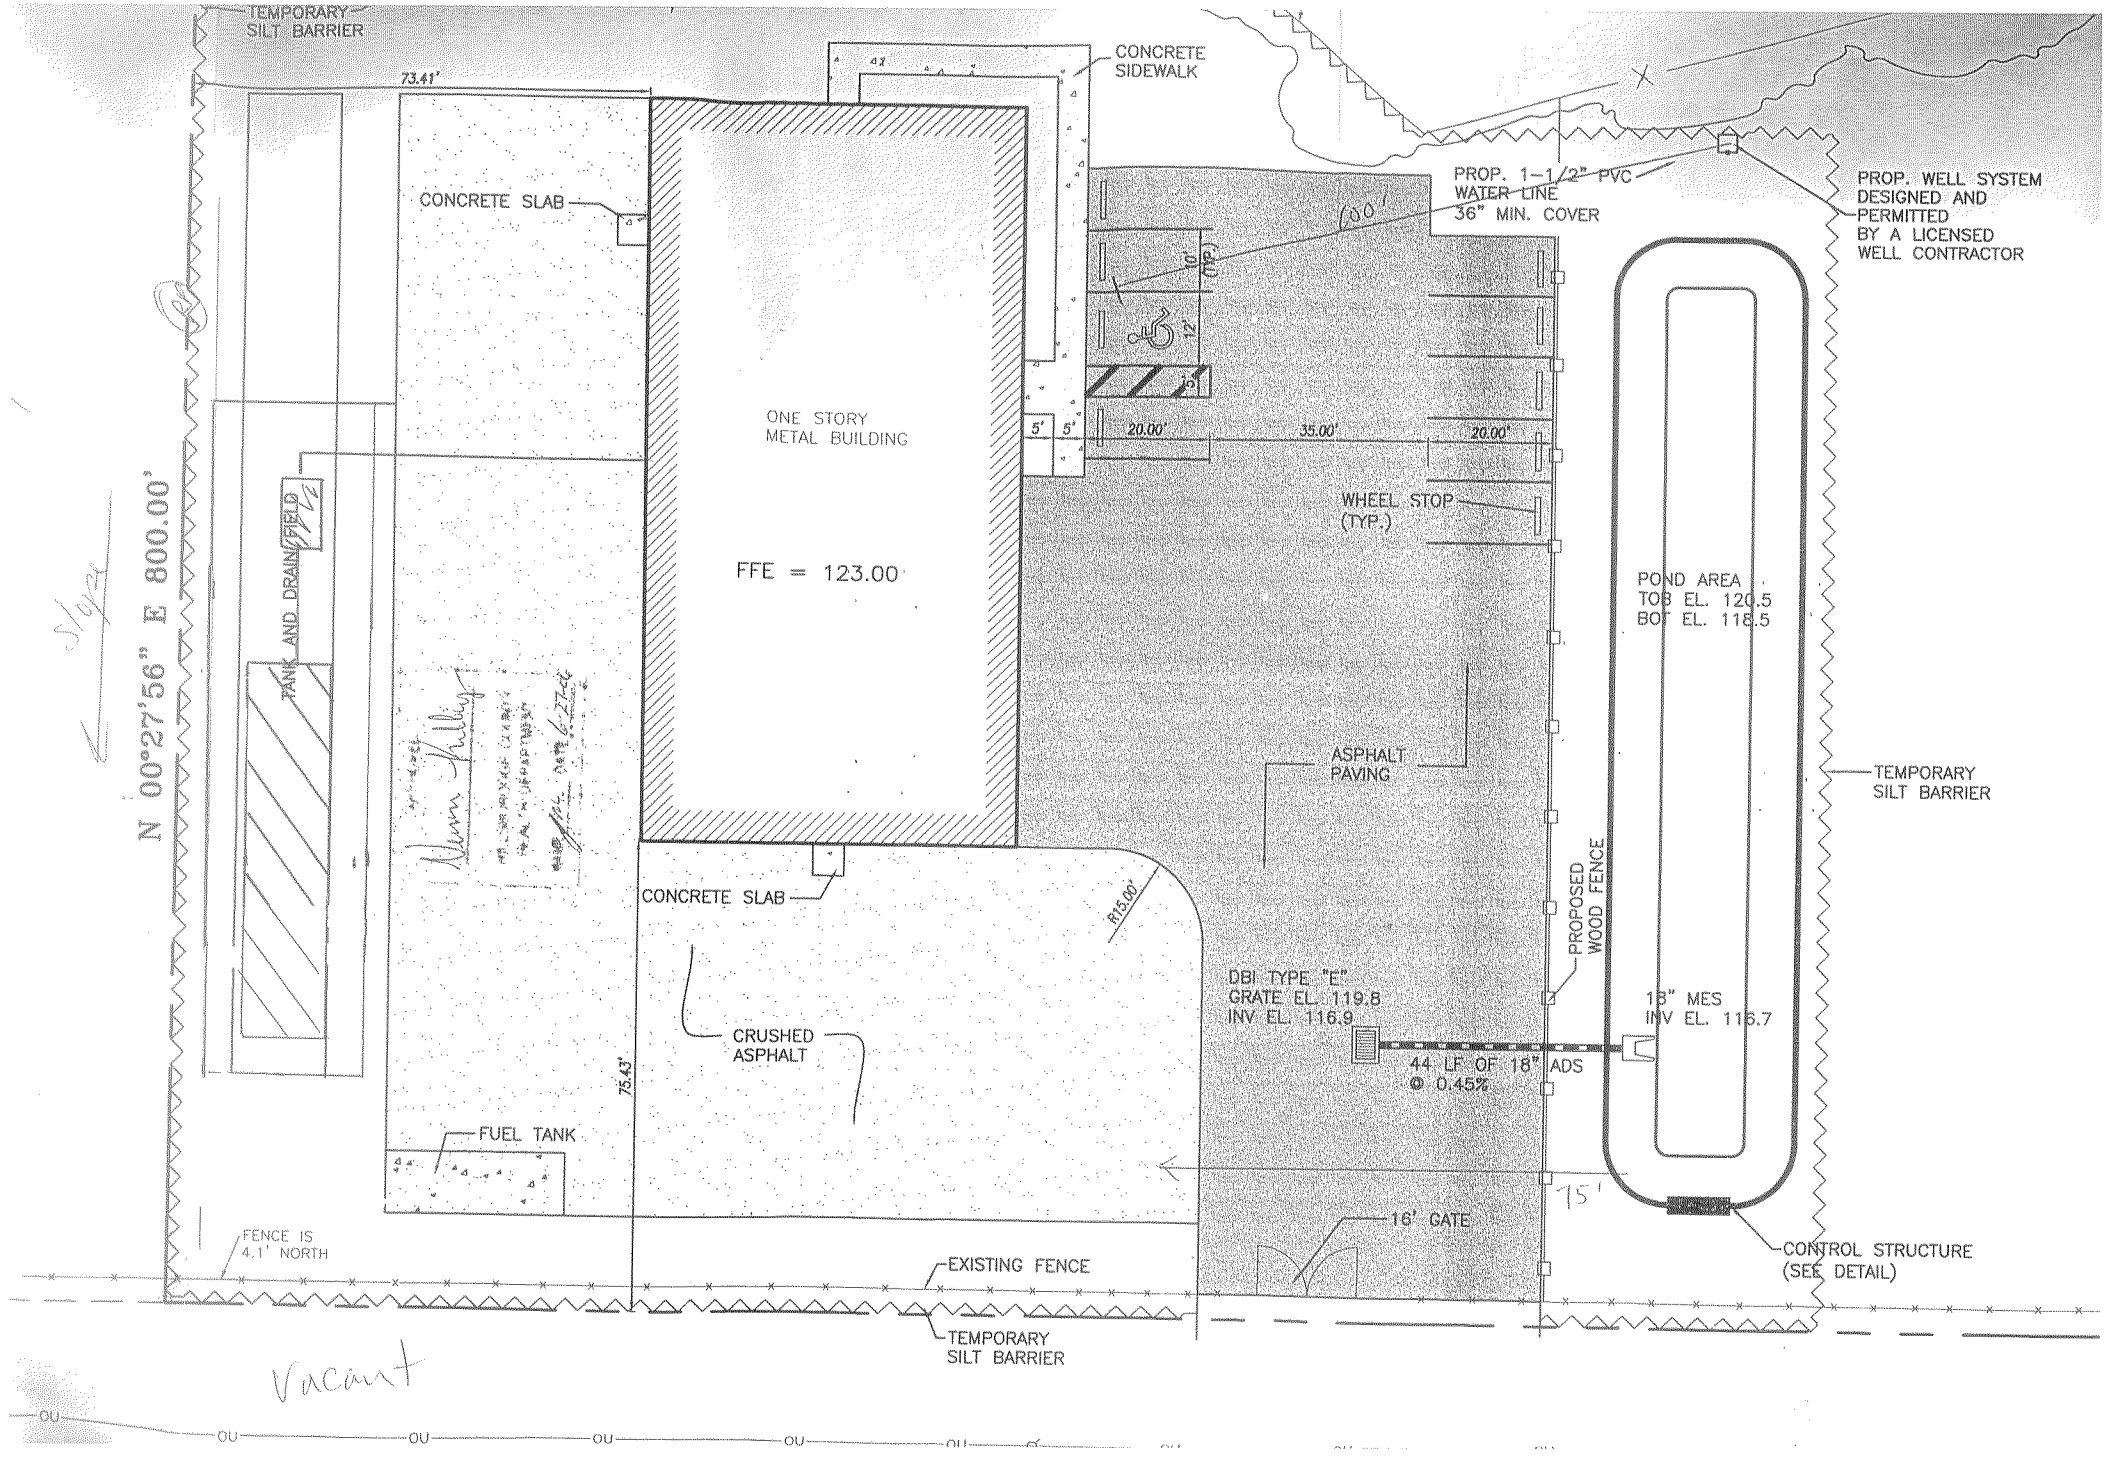
TEMPORARY SILT BARRIER
73.41'
CONCRETE SIDEWALK
CONCRETE SLAB
ONE STORY METAL BUILDING
FFE = 123.00
PROP. 1-1/2" PVC WATER LINE 36" MIN. COVER
600'
10' (TYP.)
12'
5'
5'
20.00'
35.00'
20.00'
WHEEL STOP (TYP.)
PROP. WELL SYSTEM DESIGNED AND PERMITTED BY A LICENSED WELL CONTRACTOR
POND AREA
TOB EL. 120.5
BOT EL. 118.5
TEMPORARY SILT BARRIER
N 00°27'56" E 800.00'
TANK AND DRAIN FIELD
ASPHALT PAVING
CONCRETE SLAB
R15.00'
PROPOSED WOOD FENCE
DBI TYPE "E"
GRATE EL. 119.8
INV EL. 116.9
18" MES
INV EL. 116.7
44 LF OF 18" ADS @ 0.45%
CRUSHED ASPHALT
75.43'
FUEL TANK
15'
16' GATE
CONTROL STRUCTURE (SEE DETAIL)
FENCE IS 4.1' NORTH
EXISTING FENCE
TEMPORARY SILT BARRIER
Vacant
OU